



Connecticut Department of Energy and Environmental Protection



National Emission Standards for Hazardous Air Pollutants for Reciprocating Internal Combustion Engines (RICE Rule)



40 CFR 63 Subpart ZZZZ
Area Source Existing Non-Emergency Spark Ignition
Landfill/Digester Gas Engine ≤ 500 Horsepower



Connecticut Department of Energy and Environmental Protection

To comply with this rule, you must meet the following standards:

Every 1,440 hours of operation or annually, whichever comes first, you must:

- Change oil and filter

- Can utilize oil analysis program to extend specified oil change requirement.

- Analysis must be performed every 1,440 hours or annually, whichever comes first.
 - Analysis program must at a minimum analyze: Total Acid Number, viscosity, and percent water content.
 - Condemning limits for these parameters are: Total Acid Number increases by >3.0 mg KOH/g from Total Acid Number of the oil when new; viscosity of the oil has changed by $>20\%$ from the viscosity of the oil when new; or percent water content (by volume) is >0.5 .
 - If all condemning limits are not exceeded you are not required to change the oil.
 - If any limits are exceeded, change the oil within 2 days of receiving the results of the analysis; if the engine is not in operation when the results are received, change the oil within 2 days or before commencing operation, whichever is later.
 - Keep records of parameters analyzed, results of the analysis, and oil changes.
 - Analysis program must be part of the engine maintenance plan.



To comply with this rule, you must meet the following standards:

Every 1,440 hours of operation or annually, whichever comes first, you must:

- Inspect spark plugs, hoses, and belts, and replace as necessary

At all times you must operate/maintain all equipment in a manner consistent with safety and good air pollution control practices for minimizing emissions.



You must show continuous compliance by...

- Operating and maintaining the engine according to the manufacturer's emission-related operation and maintenance instructions; or
- Develop and follow your own maintenance plan which must provide to the extent practicable for the maintenance and operation of the engine in a manner consistent with good air pollution control practice for minimizing emissions



Monitoring Requirements



Photo credit: EPA

Minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes.



Connecticut Department of Energy and Environmental Protection

To demonstrate compliance with all rule requirements, keep records of:

- Maintenance conducted on the engine to demonstrate that you operated and maintained the engine and after-treatment control device (if any) according to your own maintenance plan.
- Keep records for 5 years from the date of creation.



Connecticut Department of Energy and Environmental Protection

By when must I comply with the rule?

Your compliance date is: **October 19, 2013**



Photo credit: EPA




Connecticut Department of Energy and Environmental Protection

Visit the EPA RICE Compliance Page

www.epa.gov/ttn/atw/icengines/

- ▶ Fact sheets
- ▶ Regulations
- ▶ Example notifications
- ▶ Announcements
- ▶ Q & A documents
- ▶ Testing advice
- ▶ Recorded webinars
- ▶ ...and more!

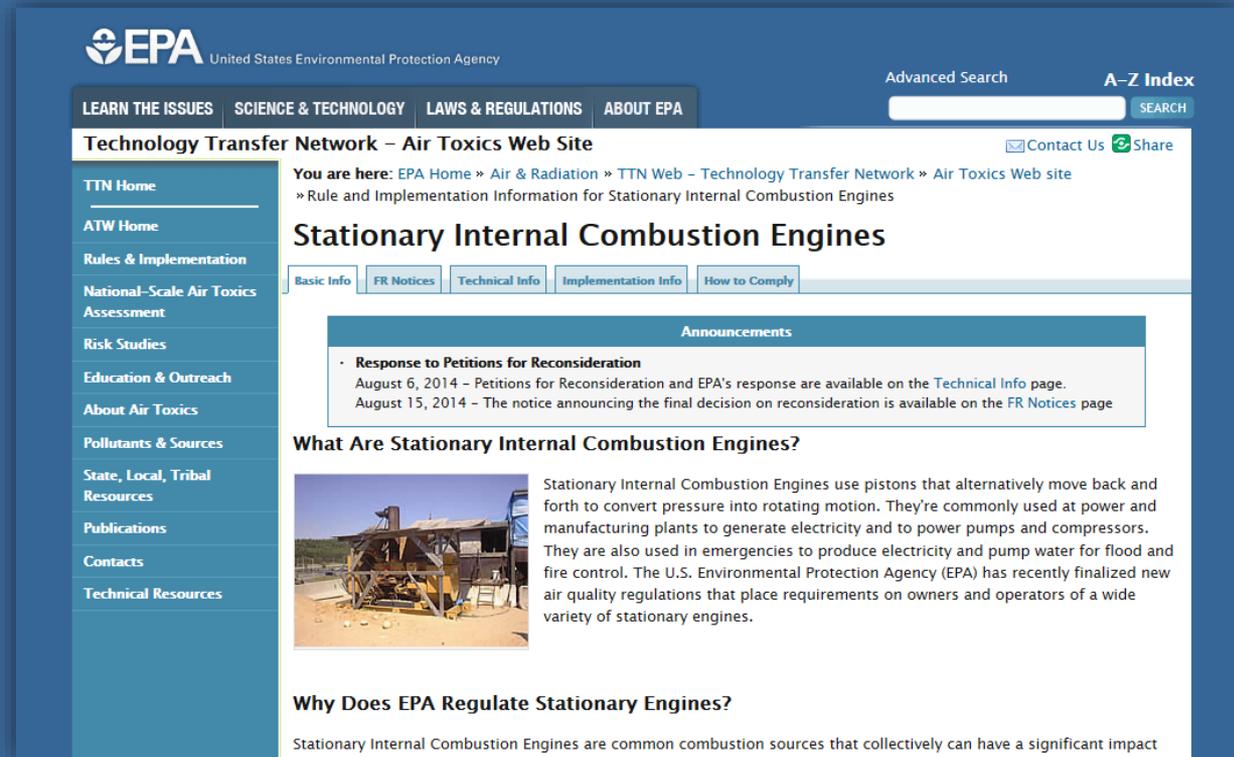

The screenshot shows the EPA website's Technology Transfer Network (TTN) page for Stationary Internal Combustion Engines. The page features a navigation menu on the left with categories like 'TTN Home', 'ATW Home', and 'Rules & Implementation'. The main content area includes a breadcrumb trail, a search bar, and a section for 'Announcements' with a link to 'Response to Petitions for Reconsideration'. Below this is a section titled 'What Are Stationary Internal Combustion Engines?' with a photograph of a large industrial engine and a brief description. The page also includes a 'Why Does EPA Regulate Stationary Engines?' section.



Connecticut Department of Energy and Environmental Protection

Take Aways

Engine Type:

- An existing non-emergency spark ignition landfill or digester gas-fired engine at an area source with a site rating of less than or equal to 500 HP

Standards:

- Change oil and filter (can use oil analysis program) and inspect spark plugs, hoses, and belts every 1,440 hours or annually (replace as necessary)

Monitoring:

- Operate/maintain engine according to manufacturer's instructions or develop maintenance plan



Take Aways

Recordkeeping:

- Keep records of engine maintenance
- Retain records for 5 years

Testing and Reporting:

- None required

Compliance Date:

- October 19, 2013

