

October 24, 2014

Mr. Mike Sanders
State of Connecticut
Department of Administrative Services
Division of Construction Services
165 Capitol Avenue, Room 460
Hartford, CT 06106

Cardno ATC

290 Roberts Street
Suite 301
East Hartford, CT 06108

Phone +1 860 282 9924
Fax +1 860 282 9826
www.cardno.com

www.cardnoatc.com

Re: Asbestos Inspection
Pumphouse
Seaside Regional Center
Waterford, Connecticut
Project MH-14-27
Building 64560
Cardno ATC Project 61.22573.0020 Task 20075


Dear Mr. Sanders:

Please find enclosed the Asbestos Inspection Report for the Pumphouse at Seaside Regional Center located in Waterford, Connecticut.

Should you have any questions concerning this report, do not hesitate to contact me at 860 282-9924 ext. 1123.

Sincerely,

Cardno ATC

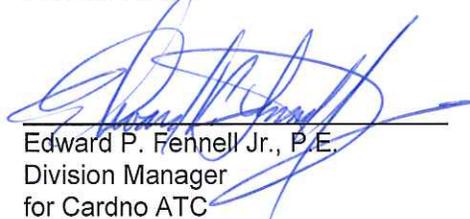


Edward P. Fennell Jr., P.E.
Division Manager
for Cardno ATC
Direct Line +1 860 282 9924 x1123
Email: edward.fennell@cardno.com

Encl:

S:\BldgSci\Clients\CTDP\W61.22573.0020.oncall.services2014\Task20075SeasidePumphouse\Documents\102414LOT AIR Seaside Pumphouse.docx

ASBESTOS INSPECTION REPORT

**PUMPHOUSE
SEASIDE REGIONAL CENTER
WATERFORD, CONNECTICUT
BUILDING 64560
PROJECT MH-14-27**

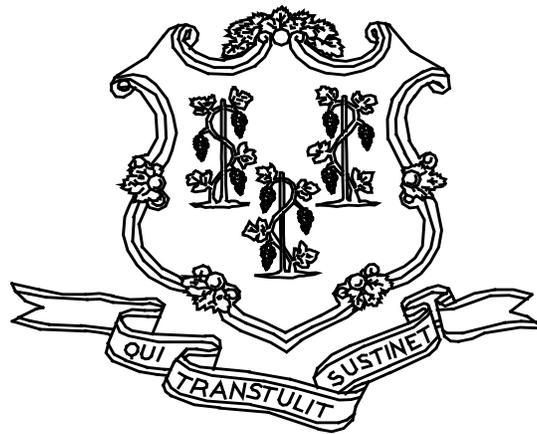

**STATE OF CONNECTICUT
DEPARTMENT OF ADMINISTRATIVE SERVICES
DIVISION OF CONSTRUCTION SERVICES**

Prepared by:

**CARDNO ATC
290 ROBERTS STREET - SUITE 301
EAST HARTFORD, CT 06108**

CARDNO ATC PROJECT 61.22573.0020 TASK 20075

OCTOBER 24, 2014

Table of Contents

TABLE OF CONTENTS

1.0	INTRODUCTION
2.0	ASBESTOS-CONTAINING MATERIALS SURVEY
3.0	ASBESTOS-CONTAINING MATERIALS
4.0	DISCUSSION AND RECOMMENDATIONS
5.0	LIMITATIONS
6.0	BULK SAMPLE SUMMARY OF SUSPECT MATERIALS
7.0	BULK SAMPLE RESULTS/CHAIN-OF-CUSTODY FORMS
APPENDIX A	LICENSE AND CERTIFICATION
APPENDIX B	DRAWINGS

1.0 INTRODUCTION

Cardno ATC (ATC) of East Hartford, Connecticut was retained by the State of Connecticut, Department of Administrative Services, Division of Construction Services (CTDCS) to conduct a limited inspection to identify asbestos-containing materials (ACM) at the Pumphouse, Seaside Regional Center, Waterford, Connecticut. The purpose of the investigation was to test suspect materials prior to renovation activities.

The inspection was conducted by Mr. Stanley Szelag and Mr. Willie L. Thompson III on October 14, 2014. Mr. Szelag and Mr. Thompson are State of Connecticut Department of Public Health (CTDPH) licensed asbestos inspectors (CTDPH license number 000493 and 000673 respectively). The survey was performed as a walk-through visual inspection, combined with the collection and analysis of bulk samples.

2.0 ASBESTOS-CONTAINING MATERIALS SURVEY

Materials which were considered suspect ACM included: vapor barrier, sheet flooring and associated mastics, caulking, glazing and roofing materials.

2.1 ASBESTOS BULK SAMPLE COLLECTION/ANALYSIS PROCEDURE

Building materials considered suspect ACM were inspected and assessed using the methods presented in the United States Environmental Protection Agency AHERA regulations (40 CFR Part 763) and NESHAP regulations (40 CFR Part 61).

ATC collected bulk samples of building materials utilizing a sampling strategy that correlated with 40 CFR 763.86 as follows:

- (a) *Surfacing materials.* An accredited inspector shall collect, in a statistically random manner that is representative of the homogeneous area, bulk samples from each homogeneous area of friable surfacing material that is not assumed to be ACM, and shall collect the samples as follows:
 - (1) At least three bulk samples shall be collected from each homogeneous area that is 1,000 ft² or less, except as provided in 40 CFR Part 763.87(c)(2).
 - (2) At least five bulk samples shall be collected from each homogeneous area that is greater than 1,000 ft² but less than or equal to 5,000 ft², except as provided in 40 CFR Part 763.87(c)(2).
 - (3) At least seven bulk samples shall be collected from each homogeneous area that is greater than 5,000 ft², except as provided in 40 CFR Part 763.87(c)(2).

- (b) *Thermal system insulation.*
 - (1) Except as provided in paragraphs (b)(2) through (4) of this section and 40 CFR Part 763.87(c), an accredited inspector shall collect, in a randomly distributed manner, at least three bulk samples from each homogeneous area of thermal system insulation that is not assumed to be ACM.
 - (2) Collect at least one bulk sample from each homogeneous area of patched thermal system insulation that is not assumed to be ACM if the patched section is less than 6 linear or square feet.

- (3) In a manner sufficient to determine whether the material is ACM or not ACM, collect bulk samples from each insulated mechanical system that is not assumed to be ACM where cement or plaster is used on fittings such as tees, elbows, or valves, except as provided under 40 CFR Part 763.87(c)(2).
 - (4) Bulk samples are not required to be collected from any homogeneous area where the accredited inspector has determined that the thermal system insulation is fiberglass, foam glass, rubber, or other non-ACM.
- (c) *Miscellaneous materials.* In a manner sufficient to determine whether material is ACM or not ACM, an accredited inspector shall collect bulk samples from each homogeneous area of friable or non-friable miscellaneous material that is not assumed to be ACM.

The bulk samples collected during the survey were analyzed by EMSL Analytical, Inc. (NVLAP Lab Code 101048-9) located in New York, New York. The bulk samples were analyzed by Polarized Light Microscopy (PLM) with dispersion staining via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s). Utilizing PLM, the microscopist is able to identify and distinguish between asbestos group minerals and other fibrous materials such as cellulose, mineral wool, fiberglass, or synthetic fibers. The quantities of each of these substances is estimated based on the procedures defined in the above-cited reference and are reported as a percentage.

The EPA recognizes the following as asbestos: Chrysotile, Crocidolite, Amosite, Tremolite, Actinolite, and Anthophyllite. To be classified as ACM, the material must be determined to contain greater than one percent (1%) asbestos. In order to consider a material to be non-ACM, all samples of a homogeneous type of material that are collected must be analyzed and all results must indicate the material to contain less than 1% asbestos by weight.

3.0 ASBESTOS-CONTAINING MATERIALS

The results of PLM laboratory analysis indicated that the following materials are asbestos-containing material (ACM). ACM are those materials that contain greater than 1% asbestos, and are as follows:

- Exterior Window Caulking
- Exterior Door Frame Caulking

The remaining materials which were sampled and tested were found to contain no detectable amounts of asbestos. Specifically, the following materials were determined to be non-ACM:

- Gray Sheet Flooring and Associated Mastic
- Vapor Barrier Mastic
- Window Glazing
- Tar Paper Under Slate Roofing

Refer to Section 6.0, Bulk Sample Summary of Suspect Materials, for all suspect materials that were identified and sampled.

4.0 DISCUSSION AND RECOMMENDATIONS

EPA regulations require the removal of Regulated Asbestos-Containing Materials (RACM) prior to renovation or demolition activities. RACM is defined as (a) Friable ACM, (b) Category I non-friable ACM that has become friable, (c) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (d) Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material in the course of demolition or renovation activities. The CTDPH defines "asbestos abatement" as removal, encapsulation, enclosure, renovation, repair, demolition, or other disturbance of ACM but does not include activities which are related to (A) the removal or repair of asbestos cement pipe and are performed by employees of a water company as defined in section 25-32a, or (B) the removal of non-friable ACM found exterior to a building or structure other than material defined as RACM in 40 CFR 61, the National Emission Standards for Hazardous Air Pollutants (NESHAP). Based upon these definitions, ACM identified in the building requires removal prior to renovation, demolition, or disturbance. The State of Connecticut, Department of Energy and Environmental Protection (CTDEEP) regulations require the proper disposal of all ACM, regardless of categorization.

5.0 LIMITATIONS

As with all such assessments, the results of the sampling represent conditions found on the date of the survey and may not represent conditions found at other times. Additionally, this assessment was limited with respect to the specific parameters indicated above and should not be construed to be a comprehensive evaluation or a definitive representation of conditions within the facility. The information presented in this report is intended to be used as a guide to evaluate the need for further investigation or the need for modifications to the processes or procedures surveyed.

6.0 BULK SAMPLE SUMMARY OF SUSPECT MATERIALS

**TABLE 6-1
BULK SAMPLE SUMMARY OF SUSPECT MATERIALS
SEASIDE REGIONAL CENTER
PUMPHOUSE**

Sample Number	Sample Location	Material	% Asbestos	Asbestos Type
101414-PH-1A	Interior	Gray Sheet Flooring	ND	
101414-PH-1B	Interior	Gray Sheet Flooring	ND	
101414-PH-2A	Interior	Gray Sheet Flooring Mastic	ND	
101414-PH-2B	Interior	Gray Sheet Flooring Mastic	ND	
101414-PH-3A	Interior Wall	Vapor Barrier Mastic	ND	
101414-PH-3B	Interior Wall	Vapor Barrier Mastic	ND	
101414-PH-4A	Exterior Window	Window Glazing	ND	
101414-PH-4B	Exterior Window	Window Glazing	ND	
101414-PH-5A	Exterior Window	Window Caulking	2	Chrysotile
101414-PH-5B	Exterior Window	Window Caulking	2	Chrysotile
101414-PH-6A	Exterior Door	Door Frame Caulking	2	Chrysotile
101414-PH-6B	Exterior Door	Door Frame Caulking	2	Chrysotile
101414-PH-7A	Exterior Roof	Tar Paper Under Slate Roofing	ND	
101414-PH-7B	Exterior Roof	Tar Paper Under Slate Roofing	ND	

ND = None Detected

7.0 BULK SAMPLE RESULTS/CHAIN-OF-CUSTODY FORMS



EMSL Analytical, Inc.

307 West 38th Street New York, NY 10018
 Phone/Fax: (212) 290-0051 / (212) 290-0058
 http://www.EMSL.com / manhattanlab@emsl.com

EMSL Order ID: 031440886
 Customer ID: ATCE54
 Customer PO: 14-061-0001A
 Project ID:

Attn: Ed Fennell Phone: (860) 282-9924
 Cardno ATC Fax: (860) 282-9826
 290 Roberts Street Collected: 10/14/2014
 Suite 301 Received: 10/23/2014
 East Hartford, CT 06108 Analyzed: 10/24/2014

Proj: 61.22573.0020T/ CT DCS/ PUMP HOUSE/ SEASIDE HOSP COMPLEX 36 SHORE RED WATER FORT CT

Summary Test Report for Asbestos Analysis of Bulk Material via EPA 600/R-93/116 Method via Polarized Light Microscopy

Client Sample ID: 101414-PH-1A **Lab Sample ID:** 031440886-0001
Sample Description: INTERIOR/SHEET FLOORING GRAY

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Brown	10%	90%	None Detected	

Client Sample ID: 101414-PH-1B **Lab Sample ID:** 031440886-0002
Sample Description: INTERIOR/SHEET FLOORING GRAY

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Brown/Gray	4%	96%	None Detected	

Client Sample ID: 101414-PH-2A **Lab Sample ID:** 031440886-0003
Sample Description: INTERIOR/SHEET FLOORING MASTIC

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Brown	0%	100%	None Detected	

Client Sample ID: 101414-PH-2B **Lab Sample ID:** 031440886-0004
Sample Description: INTERIOR/SHEET FLOORING MASTIC

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Brown	7%	93%	None Detected	

Client Sample ID: 101414-PH-3A **Lab Sample ID:** 031440886-0005
Sample Description: INT WALL/VAPOR BARRIER MASTIC

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Black	0%	100%	None Detected	

Client Sample ID: 101414-PH-3B **Lab Sample ID:** 031440886-0006
Sample Description: INT WALL/VAPOR BARRIER MASTIC

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Black	5%	95%	None Detected	

Client Sample ID: 101414-PH-4A **Lab Sample ID:** 031440886-0007
Sample Description: EXTERIOR WIND/WINDOW GLAZING

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Gray	0%	100%	None Detected	



EMSL Analytical, Inc.

307 West 38th Street New York, NY 10018
 Phone/Fax: (212) 290-0051 / (212) 290-0058
 http://www.EMSL.com / manhattanlab@emsl.com

EMSL Order ID:	031440886
Customer ID:	ATCE54
Customer PO:	14-061-0001A
Project ID:	

Summary Test Report for Asbestos Analysis of Bulk Material via EPA 600/R-93/116 Method via Polarized Light Microscopy

Client Sample ID: 101414-PH-4B **Lab Sample ID:** 031440886-0008

Sample Description: EXTERIOR WIND/WINDOW GLAZING

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	White	4%	96%	None Detected	

Client Sample ID: 101414-PH-5A **Lab Sample ID:** 031440886-0009

Sample Description: EXTERIOR WIND/WINDOW CAULKING

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Red	0%	98%	2% Chrysotile	

Client Sample ID: 101414-PH-5B **Lab Sample ID:** 031440886-0010

Sample Description: EXTERIOR WIND/WINDOW CAULKING

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Red	0%	98%	2% Chrysotile	

Client Sample ID: 101414-PH-6A **Lab Sample ID:** 031440886-0011

Sample Description: EXT DOOR/DOOR FRAME CAULKING

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Red	0%	98%	2% Chrysotile	

Client Sample ID: 101414-PH-6B **Lab Sample ID:** 031440886-0012

Sample Description: EXT DOOR/DOOR FRAME CAULKING

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Red	0%	98%	2% Chrysotile	

Client Sample ID: 101414-PH-7A **Lab Sample ID:** 031440886-0013

Sample Description: EXT ROOF/TAR PAPER UNDER SLATE

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Gray	85%	15%	None Detected	

Client Sample ID: 101414-PH-7B **Lab Sample ID:** 031440886-0014

Sample Description: EXT ROOF/TAR PAPER UNDER SLATE

TEST	Analyzed Date	Color	Non-Asbestos		Asbestos	Comment
			Fibrous	Non-Fibrous		
PLM	10/24/2014	Black	60%	40%	None Detected	



EMSL Analytical, Inc.

307 West 38th Street New York, NY 10018
Phone/Fax: (212) 290-0051 / (212) 290-0058
http://www.EMSL.com / manhattanlab@emsl.com

EMSL Order ID: 031440886
Customer ID: ATCE54
Customer PO: 14-061-0001A
Project ID:

Attn: Ed Fennell
Cardno ATC
290 Roberts Street
Suite 301
East Hartford, CT 06108
Phone: (860) 282-9924
Fax: (860) 282-9826
Collected: 10/14/2014
Received: 10/23/2014
Analyzed: 10/24/2014
Proj: 61.22573.0020T/ CT DCS/ PUMP HOUSE/ SEASIDE HOSP COMPLEX 36 SHORE RED WATER FORT CT

The samples in this report were submitted for asbestos bulk analysis. The reference number for these samples is the Order ID above. Please use this reference number when calling about these samples.

Sample Receipt Date: 10/23/2014
Analysis Completed Date: 10/24/2014

Sample Receipt Time: 11:51 am
Analysis Completed Time: 11:51 am

Analyst(s):

Emily Myint PLM (7)

Henry Akintunde PLM (7)

Reviewed and approved by:

James Hall, Laboratory Manager
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. This test report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. EMSL bears no responsibility for sample collection activities or analytical method limitations. The laboratory is not responsible for the accuracy of results when requested to physically separate and analyze layered samples. PLM alone is not consistently reliable in detecting asbestos in floor coverings and similar NOBs

Samples analyzed by EMSL Analytical, Inc. New York, NY AIHA-LAP, LLC--IHLAP Accredited #102581, NVLAP Lab Code 101048-9, NYS ELAP 11506, NJ NY022, CT PH-0170, MA AA000170



Shaping the Future

BULK SAMPLE LOG

Page 1 of 1

290 Roberts Street, Suite 301
East Hartford, CT 06108
(860) 282-9924 Fax: (860) 282-9826

031440886

Cardno ATC Inspector: W. Thompson/S. Szellag Client Name: CT P.C.S.
 Accreditation No.: 00673/00493 Project No./Task No.: 61.22573.00207
 Survey Date: 10-14-14 Project Manager: ED FENWELL
 Signature: [Signature] Requested Completion Date: _____
 Lab Name: EMSL/44 Requested turnaround time (circle): 3 HR 6 HR 24 HR 48 HR No. Samples Collected: 19
 3 DY 5 DY
 Building: PUMP HOUSE Address: SEASIDE HOSP COMPLEX - SHORE RD WATER FORT CT

Location	Material Description	Type S	Estimated Quantity	Friable Y/N	Condition (SD D ND)	Sample of homogeneous material	Field Number
INTERIOR	SHEET FLOOR INUG GRAY	MISC		N		1	101414-Ph-1A
INTERIOR	SHEET FLOORING MASTIC	M		N		2	101414-Ph-1B
INT WALLS	VAPOR BARRIER MASTIC	M		N		1	101414-Ph-2A
EXTERIOR WIND	WINDOW GARZING	M		N		2	101414-Ph-3A
EXTERIOR WIND	WINDOW GARZING	M		N		2	101414-Ph-3B
EXT DOOR	DOOR FRAME CHULKING	M		N		2	101414-Ph-4A
EXT ROOF	TARP PAPER UNDER SLATE	M		N		2	101414-Ph-4B
							101414-Ph-5A
							101414-Ph-5B
							101414-Ph-6A
							101414-Ph-6B
							101414-Ph-7A
							101414-Ph-7B

MANHATTAN LAB RECEIVED
14 OCT 23 AM 11:51

Comments: ANALYZE BY PLM


Notes
 Damage Factors: Physical (sig ding-dmg-no) Water (extensive-moderate-slight-none)
 Disturbance Factors: Proximity (<1ft-1-6ft->6ft) Accessibility (within reach-barely reachable-not reachable)
 Ventilation (yes-no; if yes, type) Air conduits (air plenum - air shaft - elevator shaft - duct)
 Friability (yes-no: hard-mod-soft surface)
 Barriers (perm airtight-encapsulated)
 Texture (rough-pitted-moderate-smooth)
 Deterioration (heavy-moderate-light-none)
 Vibration (gym-music rm-auditorium-mechanical rm-elevator-other)
 Air movement (high-moderate-low)
 Received By/Date: Emily Munt 10.24.14 8:20A
 Received By/Date: 10/23/14 11:51am
 Relinquished By/Date: S. Szellag 10-22-14
 Relinquished By/Date: Henny 10/24
 11:57am

S:\BldgSci\Admin\Templates and Forms\Asbestos\Asbestos Bulk Sample Form.doc

APPENDIX A
LICENSE AND CERTIFICATION

0002403 FP ***PRSRT T8 0 1664 06108
 STANLEY SZELAG
 290 ROBERTS ST STE 301
 ATC ASSOCIATES
 EAST HARTFORD CT 06108-3656

Dear Licensed/Certified Professional,
 Attached you will find your validated license/certification for the coming year. Should you have any questions about your license/certificate renewal, please do not hesitate to write or call:
Department of Public Health (860) 509-7603
P.O. Box 340308
M.S.#12MQA
Hartford, CT 06134-0308
<http://www.dph.state.ct.us>

Sincerely,

JEWEL MULLEN, MD, MPH, MPA, COMMISSIONER
DEPARTMENT OF PUBLIC HEALTH

INSTRUCTIONS:

1. Detach and sign each of the cards on this form.
2. Display the large card in a prominent place in your office or place of business.
3. The wallet card is for you to carry on your person. If you do not wish to carry the wallet card, place it in a secure place.
4. The employer's copy is for persons who must demonstrate current licensure/certification in order to retain employment or privileges. The employer's card is to be presented to the employer and kept by them as a part of your personnel file. Only one copy of this card can be supplied to you.

STATE OF CONNECTICUT
 DEPARTMENT OF PUBLIC HEALTH
 PURSUANT TO THE PROVISIONS OF THE GENERAL STATUTES OF CONNECTICUT
 THE INDIVIDUAL NAMED BELOW IS LICENSED
 BY THIS DEPARTMENT AS A
ASBESTOS CONSULTANT-PROJECT MONITOR

STANLEY SZELAG


LICENSE NO. 000445
 CURRENT THROUGH 01/31/15
 VALIDATION NO. 03-697204

 SIGNATURE
 COMMISSIONER

EMPLOYER'S COPY

STATE OF CONNECTICUT
 DEPARTMENT OF PUBLIC HEALTH


NAME: **STANLEY SZELAG**
 LICENSE NO.: 000445
 CURRENT THROUGH: 01/31/15
 PROFESSION: ASBESTOS CONSULTANT-PROJECT MONITOR

 SIGNATURE
 COMMISSIONER

WALLET CARD

STATE OF CONNECTICUT
 DEPARTMENT OF PUBLIC HEALTH

NAME: **STANLEY SZELAG**
 LICENSE NO.: 000445
 CURRENT THROUGH: 01/31/15
 PROFESSION: ASBESTOS CONSULTANT-PROJECT MONITOR

 SIGNATURE
 COMMISSIONER

CERTIFICATE OF ACHIEVEMENT

This certifies that

Stanley Szelag

has successfully completed the
Asbestos Site Inspector Refresher Training
Asbestos Accreditation Under TSCA Title II
40 CFR Part 763

conducted by

Cardno ATC
73 William Franks Drive
West Springfield, MA 01089
(413) 781-0070

Gregory J. Mosach

Principal Instructor

April 17, 2014

Date of Course

April 17, 2015

Expiration Date

Gregory J. Mosach

Regional Manager

SIAR-4859

Certificate Number

April 17, 2014

Examination Date

INSTRUCTIONS:

1. Detach and sign each of the cards on this form
2. Display the large card in a prominent place in your office or place of business.
3. The wallet card is for you to carry on your person. If you do not wish to carry the wallet card, place it in a secure place.
4. The employer's copy is for persons who must demonstrate current licensure/certification in order to retain employment or privileges. The employer's card is to be presented to the employer and kept by them as a part of your personnel file. Only one copy of this card can be supplied to you.

STATE OF CONNECTICUT
DEPARTMENT OF PUBLIC HEALTH

PURSUANT TO THE PROVISIONS OF THE GENERAL STATUTES OF CONNECTICUT
THE INDIVIDUAL NAMED BELOW IS CERTIFIED
BY THIS DEPARTMENT AS A
ASBESTOS CONSULTANT-INSPECTOR

WILLIE L. THOMPSON

CERTIFICATE NO.
000673

CURRENT THROUGH
08/31/16

VALIDATION NO.
03-927604

Willie Thompson
SIGNATURE

Janeel Muller
COMMISSIONER

WALLET CARD

STATE OF CONNECTICUT
DEPARTMENT OF PUBLIC HEALTH

WILLIE L. THOMPSON
NAME

CERTIFICATE NO. 000673
CURRENT THROUGH 08/31/16

03-927604
VALIDATION NO.

ASBESTOS CONSULTANT-INSPECTOR
PROFESSION

Willie Thompson
SIGNATURE

Janeel Muller
COMMISSIONER

CERTIFICATE OF ACHIEVEMENT

This certifies that

Willie L. Thompson, III

has successfully completed the
Asbestos Site Inspector Refresher Training
Asbestos Accreditation Under TSCA Title II
40 CFR Part 763

conducted by

Cardno ATC
73 William Franks Drive
West Springfield, MA 01089
(413) 781-0070

Edward Kolodziej

Principal Instructor: Edward Kolodziej

January 23, 2014

Date of Course

January 23, 2015

Expiration Date

Gregory J. March

Regional Manager: Gregory Mörtsch

SIAR-4760


Certificate Number

January 23, 2014


Examination Date

APPENDIX B
DRAWINGS



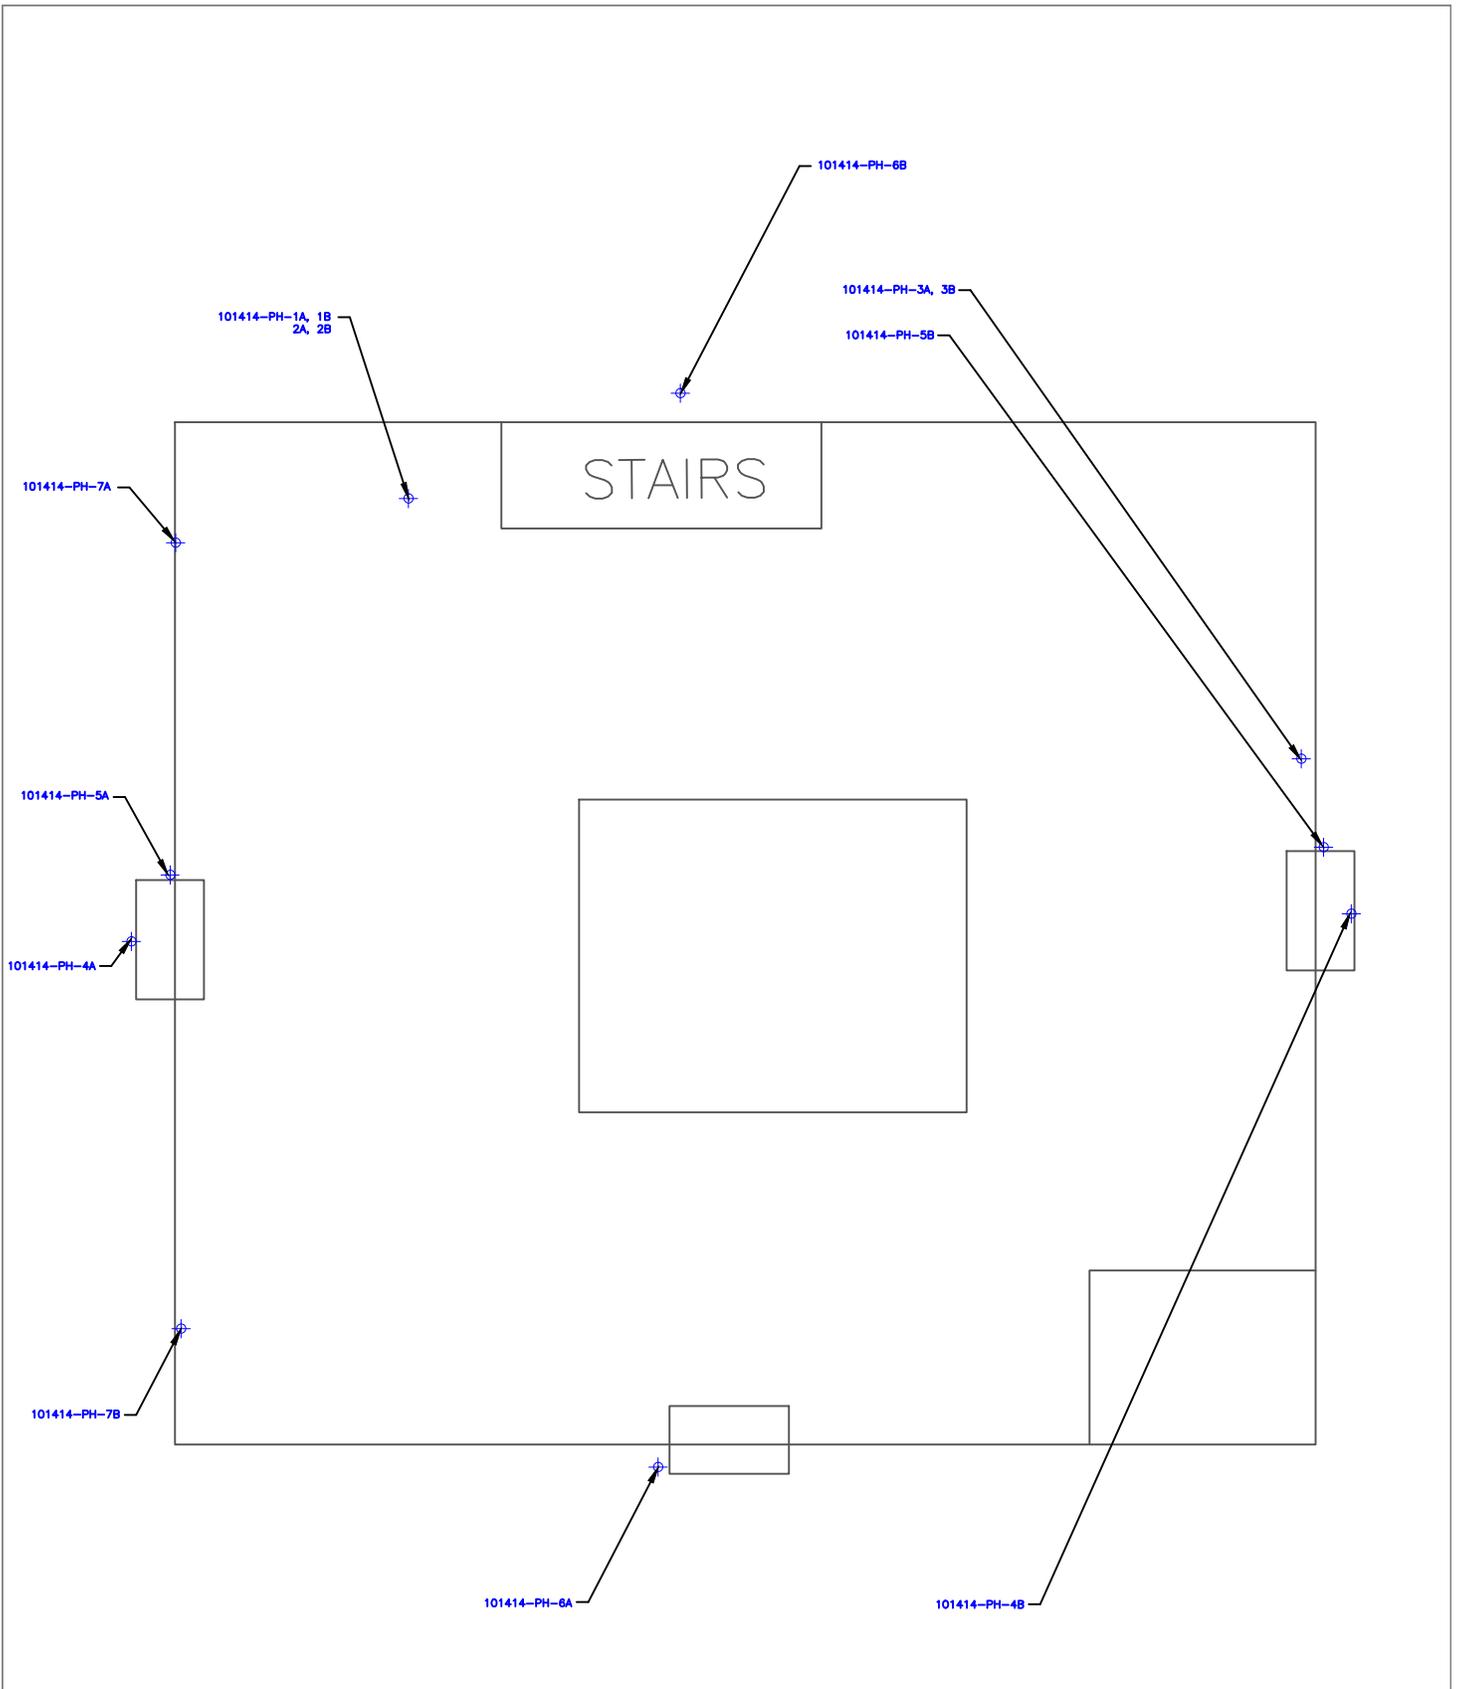

drawing title ASBESTOS SAMPLE LOCATION DIAGRAM			STATE OF CONNECTICUT DEPARTMENT OF CONSTRUCTION SERVICES	
REVISIONS			DRAWING PREPARED BY	
mark	date	description	 Cardno ATC <small>225 North Street - 30th Floor Waterford, CT 06495</small>	date 10/24/14
			project BUILDING INSPECTION PUMP HOUSE SEASIDE REGIONAL CENTER WATERFORD, CONNECTICUT	scale NTS
			CAU no.	approved by EF
			project no. 61-22573.0020 TASK 20075	drawing no. SK-1

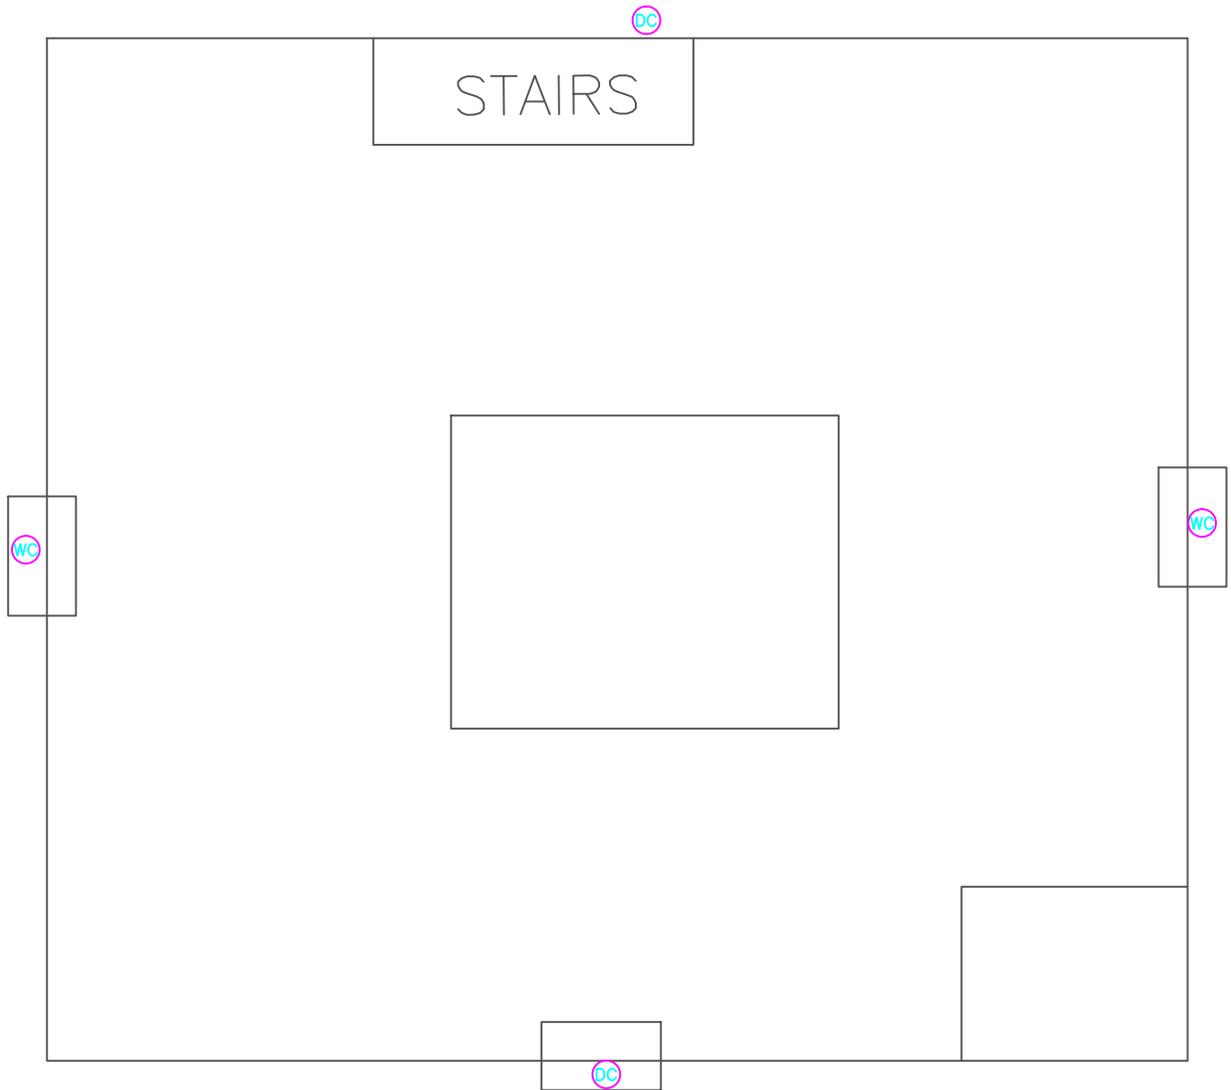

SYMBOL	MATERIAL DESCRIPTION
DC	DOOR FRAME CAULK
WC	WINDOW CAULK

NOTES

1. NOT ALL SYMBOLS IN THE LEGEND ARE USED IN THIS DRAWING.

drawing title		STATE OF CONNECTICUT DEPARTMENT OF CONSTRUCTION SERVICES	
ASBESTOS LOCATION DIAGRAM		DRAWING PREPARED BY	
REVISIONS		 200, South Street - 30th Fl Waterford, CT 06495	
mark	date	description	date
			10/24/14
			scale
			NTS
		project	drawn by
		BUILDING INSPECTION PUMP HOUSE	AMH
		SEASIDE REGIONAL CENTER WATERFORD, CONNECTICUT	approved by
			EF
			drawing no.
			ASB-1
CAU no.	project no.		
	61-22573.0020 TASK 20075		